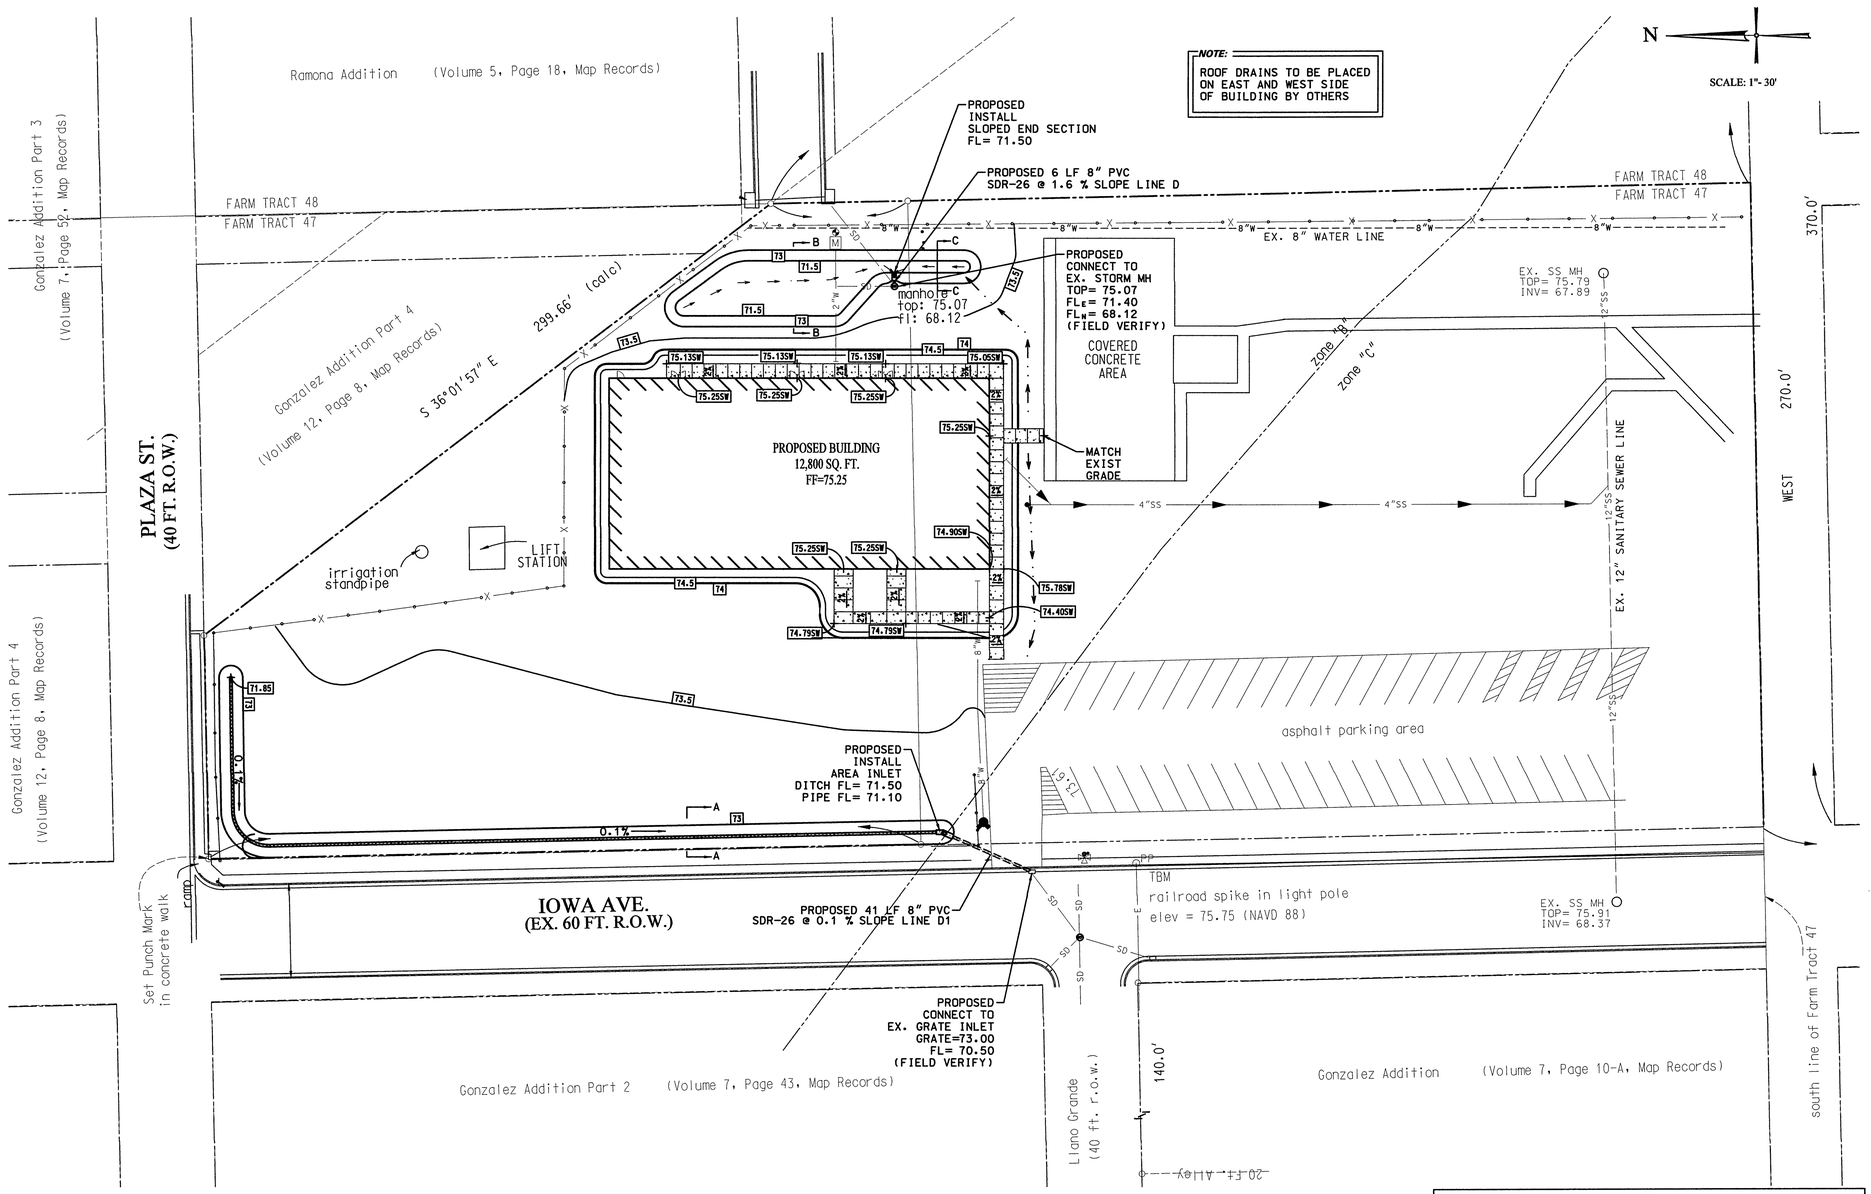

NOTE:
ROOF DRAINS TO BE PLACED ON EAST AND WEST SIDE OF BUILDING BY OTHERS

N

SCALE: 1"= 30'

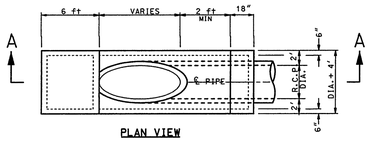

NOTES:
1. CONCRETE TO HAVE 3000 PSI MIN. 28 DAYS COMPRESSION STRENGTH.
2. STEEL TO HAVE 40,000 PSI YIELD STRENGTH.
3. DOWEL AT CONSTRUCTION JOINTS SHALL HAVE 36 X DIA. EMBEDMENT.

CROSS-SECTION A-A

SLOPED END SECTION
NTS

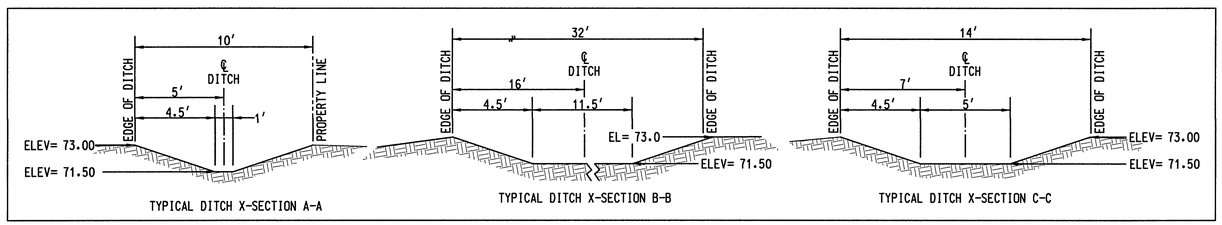

LEGEND

EXISTING	PROPOSED	DESCRIPTION
12"SS	12"SS	WASTE WATER
8"W	2"W	WASTE WATER
		FDC
PP	PP	POWER POLE
		GATE VALVE
		FIRE HYDRANT
		SS MANHOLE
		STORM MH
		INLET
	M	METER
73.2	XX.XX	GRADES
	XX.XXFF	FINISH FLOOR
	XX.XXFG	FINISH GRADE
	XX.XXSW	SIDEWALK
		DRAINAGE FLOW

CITY ON THE GROW
CITY OF WESLACO

REVISIONS:

No.	REVISION	DATE:

TITLE:
BOYS AND GIRLS CLUB AT HORTON ELEMENTARY

SEAL:
STATE OF TEXAS
MARDOQUEO HINOJOSA
107390
LICENSED
PROFESSIONAL ENGINEER
4-3-13

SHEET:
C01
GRADING AND DRAINAGE PLAN
SCALE: 1"= 30'